



12 GAUGE INSULATED SOLID  
COPPER TRACING WIRE  
(REF. WATER PANEL 10)

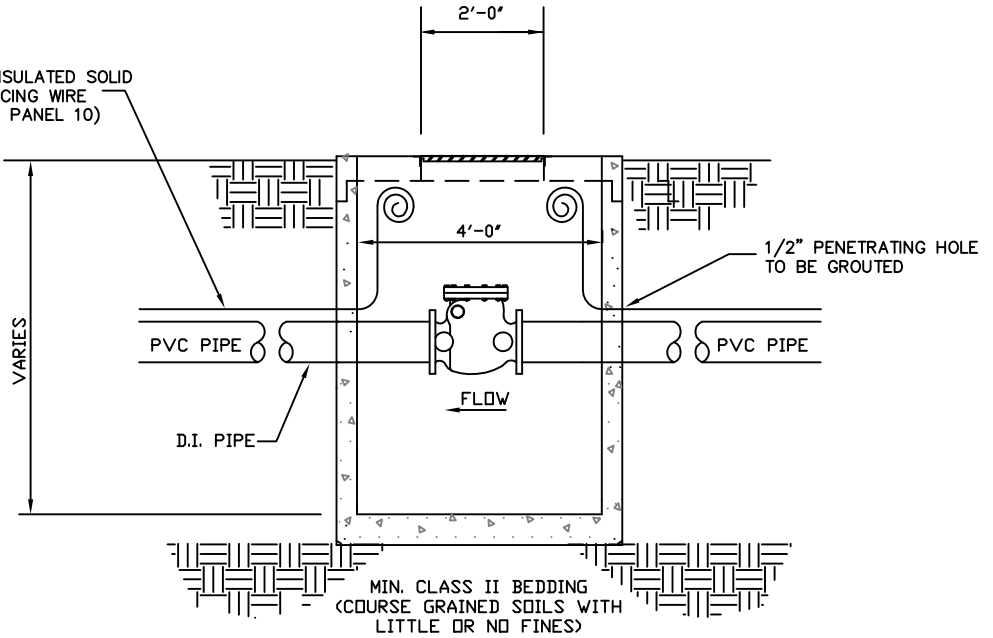

**NOTES:**

1. BOX AND TOP SHALL SUPPORT H-20 TRAFFIC LOADING
2. MANHOLE FRAME AND COVER TO BE TRAFFIC (H-20), TYPE, 24' CLEAR OPENING.
3. MANHOLE COVER TO BE WITHOUT LETTERING.

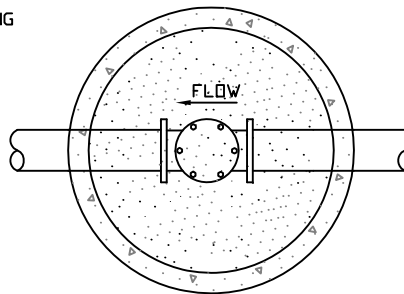

***CHECK VALVE IN PRECAST UTILITY VAULT***

NOT TO SCALE

WATER PANEL 2B

**BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED 08/01/08